


ENA EREC G99/1-4:2019

Type Test reference number		HMS-800-2T,HMS-700-2T,HMS-600-2T				
Generating Unit te	Generating Unit technology		Photovoltaic Microinverter			
System Supplier na	me	Hoymiles Power Electronics Inc.				
Address		No.18 Kangjing Road, Hangzhou, Zhejiang Province, P.R. China.				
Tel	+86 571 2805610	1	Fax	+86 571 28056137		
E:mail	zhangxingyao@ha om	zconverter.c	Web site	www.hoymiles.com		
Registered Capacity, use	0.8/0.7/0.6 per Unit	kW single p	ingle phase, single, split or three phase system			
separate sheet if	NA	kW three pl	kW three phase			
more than one	NA	kW two phases in three phase system				
connection option.	NA	kW two phases split phase system				


Manufacturer compliance declaration. - I certify that all products supplied by the company with the above Type Tested Manufacturer's reference number will be manufactured and tested to ensure that they perform as stated in this document, prior to shipment to site and that no site Modifications are required to ensure that the product meets all the requirements of EREC G99.

Note that testing can be done by the Manufacturer of an individual component or by an external test house.


Where parts of the testing are carried out by persons or organisations other than the Manufacturer then that person or organisation shall keep copies of all test records and results supplied to them to verify that the testing has been carried out by people with sufficient technical competency to carry out the tests.

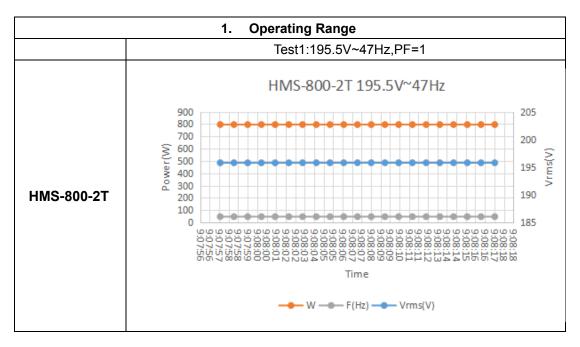




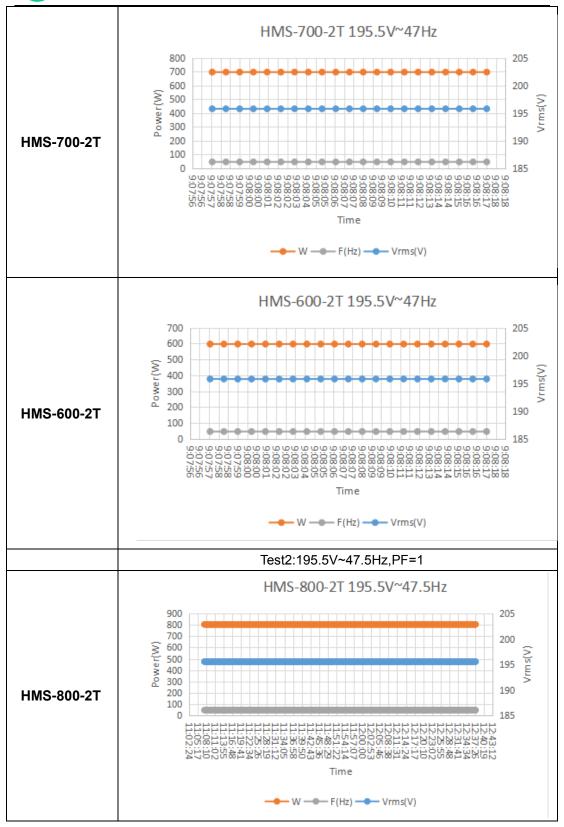




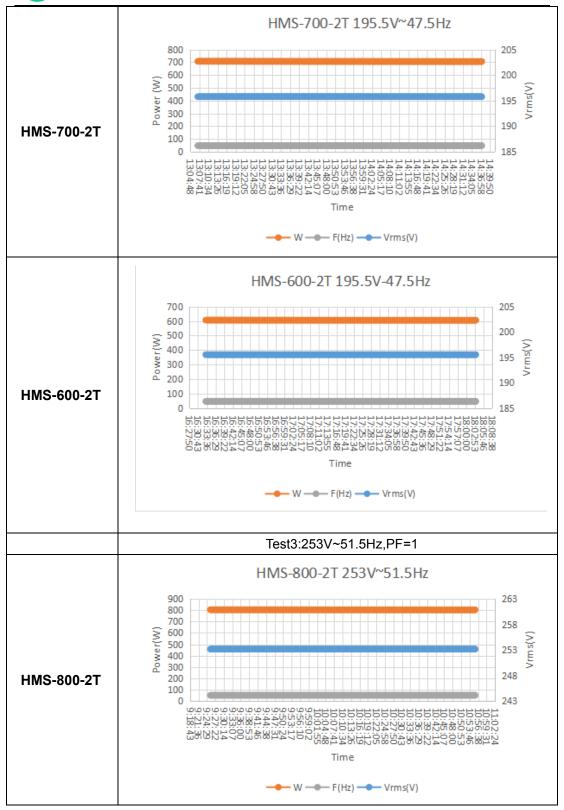




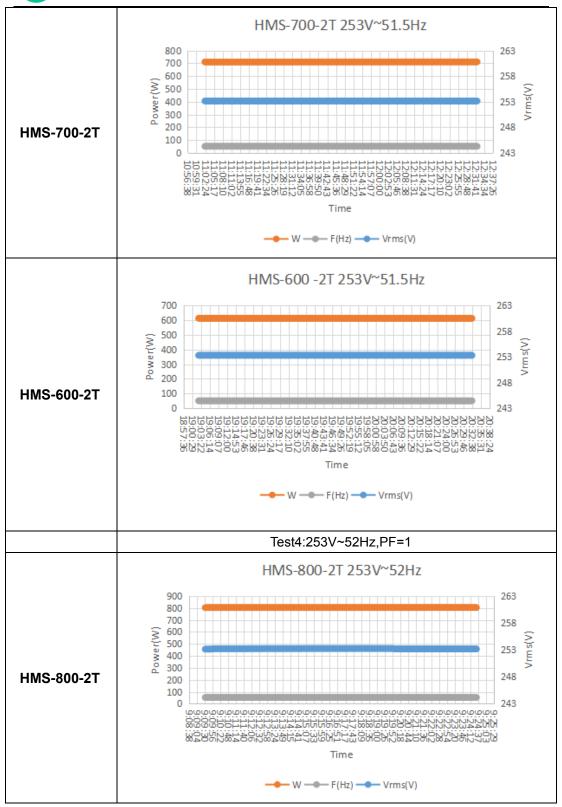



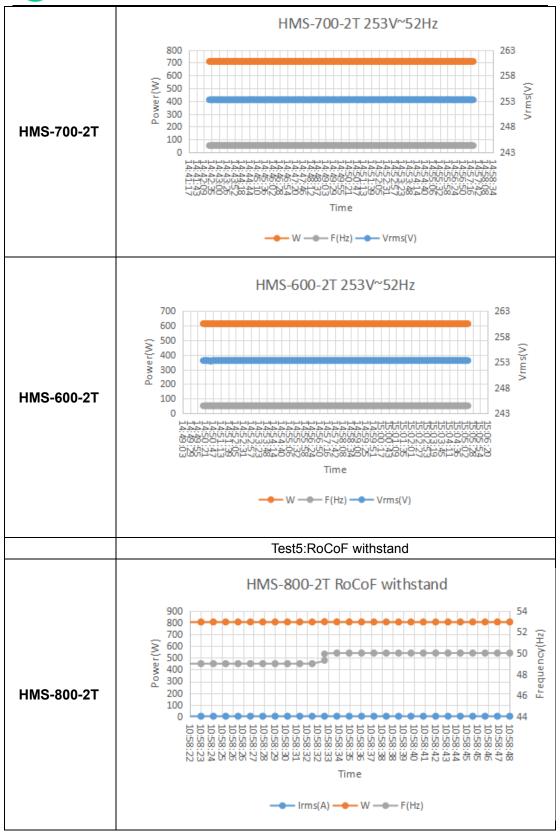



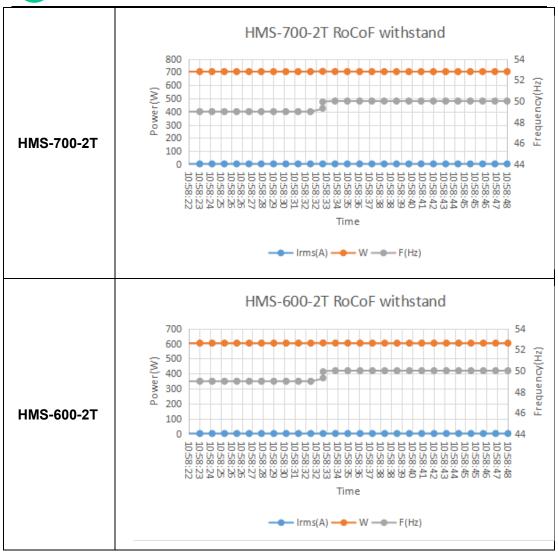

	2. Power Quality - Harmonic Generation								
Generating Unit tested to BS EN 61000-3-12									
					Harmonio	: %			
Generat	t ing Unit rating	per phase	0.8	kW	=Measure	ed Value			
(rpp)			0.8	KVV	(Amps) x	23/rating			
					per phase	e (kVA)			
Harmo	rmo A. 45 550/ of a to be to		100% of r	atad autaut	Limit in BS EN				
nic	At 45-55% 0	f rated output	100% 011	ated output	61000-3-12				
	Measured		Measured						
	Value MV	%	Value MV	%	1 phase	2 phase			
	in Amps	70	in Amps	70		3 phase			
2	0.0034	0.1290	0.0095	0.3636	8%	8%			
3	0.0045	0.1727	0.0143	0.5482	21.6%	Not			
3	0.0043	0.1727	0.0143	0.5462	21.070	stated			
4	0.0014	0.0538	0.0036	0.1390	4%	4%			
5	0.0180	0.6903	0.036	1.3811	10.7%	10.7%			

H hoymiles 垂恆

6	0.0014	0.0534	0.0035	0.1332	2.67%	2.67%
0	0.0014	0.0554	0.0033	0.1332	2.07%	2.07%
7	0.0044	0.1669	0.0035	0.1339	7.2%	7.2%
8	0.0009	0.0344	0.002	0.0767	2%	2%
9	0.0076	0.2900	0.0134	0.5153	3.8%	Not
9	0.0076	0.2900	0.0134	0.5155		stated
10	0.0007	0.0256	0.0012	0.0445	1.6%	1.6%
11	0.0023	0.0864	0.0056	0.2145	3.1%	3.1%
12	0.0003	0.0116	0.0013	0.0511	1.33%	1.33%
13	0.0065	0.2509	0.0098	0.3759	2%	2%
THD		3.2580		3.1940	23%	13%
PWHD		5.3458		3.8648	23%	22%
system s	size is scalable	this is the syst	em size tested	by 1 Unit (HMS	-800-2T).	

3. Power Quality. Voltage fluctuations and Flicker								
Test to BS EN 61000-3-11								
	Startin	g		Stoppi	ng		Running	
	dmax [%]	dc [%]	d(t) [%]	dmax [%]	dc [%]	d(t) [%]	Pst	Plt 2 hours
Measured Values								
at	0.36	0.3	0	0.36	0.3	0	0.133	0.058
test impedance								
Normalised to standard impedance	0.36	0.3	0	0.36	0.3	0	0.133	0.058
Normalised to								
required maximum	0.36	0.3	0	0.36	0.3	0	0.133	0.058
impedance								
Limits set under BS EN 61000-3-11	4%	3.3%	3.3%	4%	3.3%	3.3%	1	0.65
Test impedance	R	0.4		Ω	ΧI	0.25		Ω
Standard		0.24*		0		0.15*		_
impedance	R	0.4^		Ω	XI	0.25^		Ω
Maximum impedance	R	0.4		Ω	XI	0.25		Ω
				Test				
Test start date		2020-07-31		end	2020-07-31			
				date				
Test location							N INSTITU CO., LTD	

4. Power quality. DC injection



Test power level	10%	55%	100%
Recorded value(mA)	0.016	0.056	2.952
as % of rated AC	0.0040/	0.0040/	0.0050/
current	0.004%	0.004%	0.085%
Limit	0.25%	0.25%	0.25%

5. Power Quality. Power factor							
	216.2V	230V	253V	Measured at three voltage levels			
Measured value	0.9958	0.9952	0.9945	and at full output. Voltage to be maintained within ±1.5% of the			
Limit	>0.95	>0.95	>0.95	stated level during the test.			

6. Protection. Frequency tests								
Function	Setting		Trip test		"No trip tests"			
	Frequency	Time delay	Frequency	Time delay	Frequency /time	Confirm no trip		
U/F stage 1	47.5Hz	20s	47.5Hz	20.1s	47.7Hz/30s	Confirmed		
U/F stage 2	47Hz	0.5s	47Hz	0.52s	47.2Hz/19.5s	Confirmed		
					46.8Hz/0.45s	Confirmed		
O/F stage 1	52Hz	0.5s	52Hz	0.53s	51.8Hz/120s	Confirmed		
						Confirmed		

7. Protection. Voltage tests								
Function	Setting		Trip test		"No trip tests"			
	Voltage	Time delay	Voltage	Time delay	Voltage /time	Confirm no trip		
U/V stage 2	184V	2.5s	183.4V	2.53s	188V/5.0s	Confirmed		
					180V/2.45s	Confirmed		
OV stage 1	262.2V	1.0s	262.8V	1.03s	258.2V/5.0s	Confirmed		
O/V stage 2	273.7V	0.5s	274.4V	0.52s	269.7V/0.95s	Confirmed		
					277.7V/0.45s	Confirmed		

8. Power Park Modules - Protection - Loss of Mains test								
Note: Inverter tested according to BS EN 62116.								
Test Power and imbalance	33% -5% Q	66% -5% Q	100% -5% P	33% +5% Q	66% +5% Q	100% +5% P		
	Test 22	Test 12	Test 5	Test 31	Test 21	Test 10		
Trip time. Limit is 0.5s	45.13ms	411.2ms	325.2ms	57.23ms	411.5ms	336.5ms		

9. Loss of Mains Protection, Vector Shift Stability test and RoCoF Stability test								
	Start Change		End	Confirm no trin				
	Frequency	Change	Frequency	Confirm no trip				
Positive Vector Shift	49.5Hz	+50 degrees		Confirmed				
Negative Vector Shift	50.5Hz	- 50 degrees		Confirmed				



	Ramp range	Test frequency ramp	Test Duration	Confirm no trip
Positive Frequency drift	49Hz to 51Hz	+0.95Hz/sec	2.1s	Confirmed
Negative Frequency drift	51Hz to 49Hz	-0.95Hz/sec	2.1s	Confirmed

10. Limited Frequency Sensitive Mode - Over frequency test					
Active Power response to rising frequency/time plots are attached if					
frequency injection tests are undertaken in accordance with Annex A.8.2.4 N					
Test sequence	Measured	Frequency	Primary	Active	
at Registered	Active		Power	Power	
Capacity >80	Power Output		Source	Gradient	
%					
Step a) 50.00Hz	800.3W	50Hz		-	
±0.01Hz	800.344				
Step b) 50.45Hz	790.9W	50.45Hz		-	
±0.01Hz	790.9				
Step c) 50.70Hz	755.1W	50.7Hz		-	
±0.10Hz	755.177				
Step d) 51.15Hz	603 3///	51.15Hz		-	
±0.05Hz	683.3W				
Step e) 50.70Hz	754.0\\\	50.7Hz		-	
±0.10Hz	751.3W				
Step f) 50.45Hz	704.4\\\	50.45Hz		-	
±0.05Hz	791.1W				
Step g) 50.00Hz	000 411/	50Hz		-	
±0.01Hz	800.1W				
Test sequence	Measured	Frequency	Primary	Active	
at Registered	Active		Power	Power	
Capacity	Power Output		Source	Gradient	
40%~60%					
Step a) 50.00Hz	406 7\\\	50Hz		-	
±0.01Hz	406.7W				
Step b) 50.45Hz	200.4\\\	50.45Hz		-	
±0.05Hz	399.1W				
Step c) 50.70Hz	202.214	50.7Hz]	-	
±0.10Hz	382.3W				
Step d) 51.15Hz	240.0\4	51.15Hz		-	
±0.05Hz	349.9W				
Step e) 50.70Hz	202 5144	50.7Hz	1	-	
±0.10Hz	382.5W				

11. Protection. Re-connection timer



Test should prove that the reconnection sequence starts in no less than 20s for restoration of voltage and frequency to within the stage 1 settings of table 10.5.7.1					
Time delay setting	Measured delay	Checks on no reconnection when voltage or frequency is brought to just outside stage 1 limits of table 10.5.7.1.			
20s	30s	At 266.2V	At 180V	At 47.4Hz	At 52.1Hz
Confirmation that the Generating Unit does not re-connect.		Confirmed	Confirmed	Confirmed	Confirmed

12. Fault level contribution					
For machines w	ith electro-maر	gnetic output	For Inverter output		
Parameter	Symbol	Value	Time after fault	Volts	Amps
Peak Short Circuit current	ip	N/A	20ms	19.25V	0.153A
Initial Value of aperiodic current	А	N/A	100ms	10.26V	0.121A
Initial symmetrical short-circuit current*	lk	N/A	250ms	9.24V	0.116A
Decaying (aperiodic) component of short circuit current*	iDC	N/A	500ms	5.98V	0.109A
Reactance/Re sistance Ratio of source*	X/R	N/A	Time to trip	0.0032	(in seconds)

For rotating machines and linear piston machines the test should produce a 0s - 2s plot of the short circuit current as seen at the Generating Unit terminals.

* Values for these parameters should be provided where the short circuit duration is sufficiently long to enable interpolation of the plot

	13. Self-Monitoring solid state switching	Yes/or NA
-	It has been verified that in the event of the solid state switching device failing to disconnect the Generating Unit , the voltage on the output side of the switching device is reduced to a value below 50 Volts within 0.5 seconds	N/A

14. Wiring functional tests: If required by para 15.2.1	Yes/or NA	
Confirm that the relevant test schedule is attached (tests to be undertaken at	N/A	
time of commissioning).	IN/A	



15. Logic interface (input port)	Yes/or NA	
Confirm that an input port is provided and can be used to shut down the	Yes	
module.		